



FB Remote I/O Field Unit

FB9211-T6*-*-***-**-*-Y*

- Preconfigured enclosures for engineered FB systems
- Installation in Zone 1 and Zone 21
- Installation in Zone 2 and Zone 22
- Max. 10 slots for I/O modules
- Impact resistance enclosure, IP66
- Redundancy (field bus and power supply)
- For PROFIBUS DP, PROFIBUS DP V1, MODBUS RTU and MODBUS TCP
- Image is generic for this device type and may deviate from the specific variant


Field Unit, Stainless Steel



Function

This field unit is designed to meet the requirements of the most demanding hazardous area and industrial environmental applications. Brushed stainless steel 316L provides high corrosion and impact resistance at a very wide temperature range. It is equipped with a base backplane which allows redundancy in gateway and power supply. It provides 10 slots for I/O modules. The I/O modules can be plugged anywhere on each slot. The fieldbus and power supply are equipped with redundant connections.

Dimensions

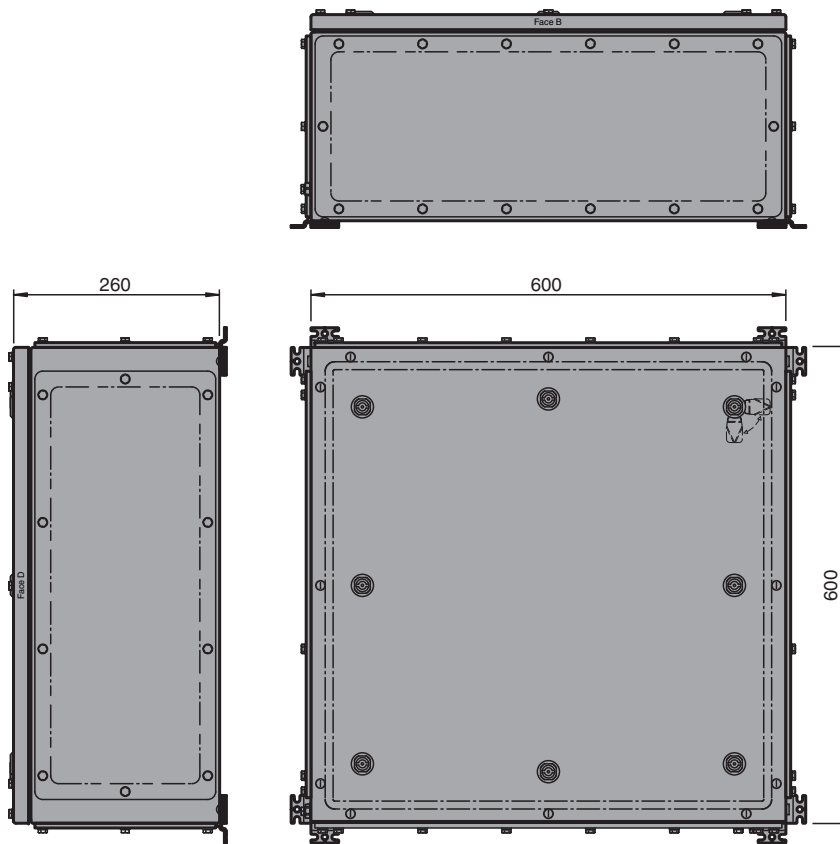

Technical Data

General specifications		
Installed components	1x backplane FB9262BP10220.x	
Slots		
Bus coupler	2	
Bus termination	2	
Supply	2	
I/O modules (single width)	max. 10	
I/O modules (dual width)	max. 5	
Supply		
Connection	screw terminals, max. 10 mm ²	
Rated voltage	U _r	24 V DC/115 V AC/230 V AC , depends on power supply
Redundancy	yes	
Fieldbus connection		
Fieldbus type	PROFIBUS DP/DP-V1, MODBUS RTU, or MODBUS TCP , depends on bus coupler	
Connection	spring terminal, max. 2.5 mm ²	
Redundancy	yes	
Directive conformity		
Electromagnetic compatibility		
Directive 2014/30/EU	EN 61439-1:2012 (J.9.2.2 b) , EN 61439-2:2012	
Conformity		
Degree of protection	EN 60529	
Impact resistance	EN 60079-0	

Release date: 2022-07-13 Date of issue: 2022-07-13 Filename: t196786_eng.pdf

Technical Data

Ambient conditions	
Ambient temperature	-20 ... 40 °C (-4 ... 104 °F) further on request
Storage temperature	-25 ... 70 °C (-13 ... 158 °F)
Relative humidity	< 75 % (annual mean) < 95 % (30 d/year), no moisture condensation
Shock resistance	shock type I, shock duration 11 ms, shock amplitude 15 g, number of shocks 18
Vibration resistance	frequency range 10 ... 150 Hz; transition frequency: 57.56 Hz, amplitude/acceleration ± 0.075 mm/1 g; 10 cycles frequency range 5 ... 100 Hz; transition frequency: 13.2 Hz amplitude/acceleration ± 1 mm/0.7 g; 90 minutes at each resonance
Impact resistance	7J
Mechanical specifications	
Enclosure cover	hinged door with quarter-turn key locks
Cover seal	foamed silicone
Degree of protection	IP66
Cable entry face B	
M16 quantity	54
M16 series	Cable Glands, Plastic
M16 type	CG.PIDS1.M16.*
M16 clamping range	4 ... 8 mm
M16 info	field signals
M20 quantity	7
M20 series	Cable Glands, Plastic
M20 type	CG.PEDS1.M20.*
M20 clamping range	6 ... 12 mm
M20 info	Fieldbus
M25 quantity	4
M25 series	Cable Glands, Plastic
M25 type	CG.PEDS1.M25.*
M25 clamping range	10 ... 18 mm
M25 info	Power Supply
Terminal assembly	
Number of horizontal rails	1
Usable length per horizontal rail	470 mm
Terminal type	max. 90 spring terminal or screw terminal
Material	
Enclosure	1.5 mm AISI 316L, (1.4404) stainless steel
Finish	brushed
Cable gland	Polyamide (PA)
Seal	housing: foamed silicone cable gland: chloroprene
Mass	approx. 25 kg , without modules
Dimensions	
External dimension (A)	600 mm
External dimension (B)	600 mm
External dimension (C)	260 mm
Mounting	4 Mounting bracket for wall mounting included in the scope of delivery
Grounding	M8 internal/external brass nickel-plated grounding bolt
Data for application in connection with hazardous areas	
EU-type examination certificate	PTB 97 ATEX 1075 X
Marking	Ⓜ II 2(1)G Ex db eb ia mb q [ia Ga/ib] IIC T4 Gb Ⓜ II 2(1)D Ex tb [ia Da/ib] IIIC T130°C Db
Directive conformity	
Directive 2014/34/EU	EN 60079-0:2018 , EN 60079-1:2014 , EN 60079-5:2015 , EN 60079-7:2015 , EN 60079-11:2012 , EN 60079-18:2015 , EN 60079-31:2014
General information	

Release date: 2022-07-13 Date of issue: 2022-07-13 Filename: t196786_eng.pdf

Technical Data

Ordering information	This device will be delivered completely configured and assembled ready for use. For configuration details please contact Customer Service.
Supplementary information	EC-Type Examination Certificate, Statement of Conformity, Declaration of Conformity, Attestation of Conformity and instructions have to be observed where applicable. For information see www.pepperl-fuchs.com .